

**GOCE DELCEV UNIVERSITY, STIP, NORTH MACEDONIA
FACULTY OF ELECTRICAL ENGINEERING**

ETIMA 2025
THIRD INTERNATIONAL CONFERENCE
24-25 SEPTEMBER, 2025



**TECHNICAL SCIENCES APPLIED IN ECONOMY,
EDUCATION AND INDUSTRY**



УНИВЕРЗИТЕТ
ГОЦЕ ДЕЛЧЕВ
ЕЛЕКТРОТЕХНИЧКИ
ФАКУЛТЕТ



УНИВЕРЗИТЕТ „ГОЦЕ ДЕЛЧЕВ“, ШТИП
ЕЛЕКТРОТЕХНИЧКИ ФАКУЛТЕТ

GOCE DELCEV UNIVERSITY, STIP
FACULTY OF ELECTRICAL ENGINEERING

ТРЕТА МЕЃУНАРОДНА КОНФЕРЕНЦИЈА
THIRD INTERNATIONAL CONFERENCE

ЕТИМА / ETIMA 2025

ЗБОРНИК НА ТРУДОВИ
CONFERENCE PROCEEDINGS

24-25 септември 2025 | 24-25 September 2025

ISBN: 978-608-277-128-1

DOI: <https://www.doi.org/10.46763/ETIMA2531>

Главен и одговорен уредник / Editor in Chief

проф.д-р Сашо Гелев
Prof.d-r Saso Gelev

Јазично уредување / Language Editor

Весна Ристова (македонски) / Vesna Ristova (Macedonian)

Техничко уредување / Technical Editing

Дарко Богатинов / Darko Bogatinov

Издавач / Publisher

Универзитет „Гоце Делчев“, Штип / Goce Delcev University, Stip
Електротехнички факултет / Faculty of Electrical Engineering

Адреса на организационен комитет / Address of the organizational committee

Универзитет „Гоце Делчев“, Штип / Goce Delcev University, Stip
Електротехнички факултет / Faculty of Electrical Engineering

Адреса: ул. „Крсте Мисирков“ бр. 10А / Address: Krste Misirkov, 10A

Пош. фах 201, Штип - 2000, С. Македонија / PO BOX 201, Stip 2000, North Macedonia

E-mail: conf.etf@ugd.edu.mk

CIP - Каталогизација во публикација

Национална и универзитетска библиотека "Св. Климент Охридски", Скопје

62-049.8(062)

004-049.8(062)

МЕЃУНАРОДНА конференција ЕТИМА (3 ; 2025 ; Штип)

Зборник на трудови [Електронски извор] / Трета меѓународна конференција ЕТИМА 2025, 24-25 септември 2025 ; [главен и одговорен уредник Сашо Гелев] = Conference proceedings / Third international conference, 24-25 September 2025 ; [editor in chief Saso Gelev]. - Текст во PDF формат, содржи 357 стр., илустр. - Штип : Универзитет "Гоце Делчев", Електротехнички факултет ; Штип : "Goce Delchev" University, Faculty of Electrical engineering, 2025

Начин на пристапување (URL): <https://js.ugd.edu.mk/index.php/etima/en>. - Наслов преземен од екранот. - Опис на изворот на ден 30.10.2025. - Трудови на мак. и англ. јазик. - Библиографија кон трудовете

ISBN 978-608-277-128-1

**а) Електротехника -- Примена -- Собири б) Машинство -- Примена -- Собири
в) Автоматика -- Примена -- Собири г) Информатика -- Примена -- Собири**

COBISS.MK-ID 67297029



Трета меѓународна конференција ЕТИМА
24-25 Септември 2025
Third International Conference ETIMA
24-25 September 2025

**ОРГАНИЗАЦИОНЕН ОДБОР
ORGANIZING COMMITTEE**

Драган Миновски / Dragan Minovski

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Сашо Гелев / Saso Gelev

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Тодор Чекеровски / Todor Cekеровски

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Маја Кукушева Панева / Maja Kukuseva Paneva

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Билјана Читкушева Димитровска / Biljana Citkuseva Dimitrovska

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Дарко Богатинов / Darko Bogatinov

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia



Трета меѓународна конференција ЕТИМА
24-25 Септември 2025
Third International Conference ETIMA
24-25 September 2025

**ПРОГРАМСКИ И НАУЧЕН ОДБОР
SCIENTIFIC COMMITTEE**

Антонио Курадо / António Curado

Политехнички институт во Виана до Кастело, Португалија
Instituto Politécnico de Viana do Castelo, Portugal

Стелијан – Емилијан Олтеан / Stelian –Emilian Oltean

Факултет за инженерство и информатичка технологија,
Медицински универзитет Ѓеорге Емил Паладе, фармација, наука и технологија
во Таргу Муреш, Романија
Faculty of Engineering and Information Technology, George Emil Palade
University of Medicine, Pharmacy, Science, and Technology of Targu Mures, Romania

Митко Богданоски / Mitko Bogdanoski

Воена академија, Универзитет „Гоце Делчев“, Северна Македонија
Military Academy, Goce Delcev University, North Macedonia

Верица Тасеска Ѓоргиевска / Verica Taseska Gjorgievska

Македонска академија на науките и уметностите, Северна Македонија
Macedonian Academy of Sciences and Arts, North Macedonia

Југослав Ачкоски / Jugoslav Ackoski

Воена академија, Универзитет „Гоце Делчев“, Северна Македонија
Military Academy, Goce Delcev University, North Macedonia

Димитар Богатинов / Dimitar Bogatinov

Воена академија, Универзитет „Гоце Делчев“, Северна Македонија
Military Academy, Goce Delcev University, North Macedonia

Со Ногучи / So Noguchi

Висока школа за информатички науки и технологии
Универзитет Хокаидо, Јапонија
Graduate School of Information Science and Technology
Hokkaido University, Japan

Диониз Гашпаровски / Dionýz Gašparovský

Факултет за електротехника и информатички технологии,
Словачки Технички Универзитет во Братислава, Словачка
Faculty of Electrical Engineering and Information Technology
Slovak Technical University in Bratislava, Slovakia

Георги Иванов Георгиев / Georgi Ivanov Georgiev
Технички Универзитет во Габрово, Бугарија
Technical University in Gabrovo, Bulgaria

Антон Белан / Anton Belán
Факултет за електротехника и информации технологии
Словачки Технички Универзитет во Братислава, Словачка
Faculty of Electrical Engineering and Information Technology
Slovak Technical University in Bratislava, Slovakia

Ивелина Стефанова Балабанова / Ivelina Stefanova Balabanova
Технички Универзитет во Габрово, Бугарија
Technical University in Gabrovo, Bulgaria

Бојан Димитров Карапeneв / Boyan Dimitrov Karapenev
Технички Универзитет во Габрово, Бугарија
Technical University in Gabrovo, Bulgaria

Сашо Гелев / Saso Gelev
Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Влатко Чингоски / Vlatko Cingoski
Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Божо Крстајиќ / Bozo Krstajic
Електротехнички факултет
Универзитет во Црна Гора, Црна Гора
Faculty of Electrical Engineering,
University in Montenegro, Montenegro

Милован Радуловиќ / Milovan Radulovic
Електротехнички факултет
Универзитет во Црна Гора, Црна Гора
Faculty of Electrical Engineering,
University in Montenegro, Montenegro

Гоце Стефанов / Goce Stefanov
Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Мирјана Периќ / Mirjana Peric
Електронски факултет
Универзитет во Ниш, Србија
Faculty of Electronic Engineering,
University of Nis, Serbia

Ана Вучковиќ / Ana Vuckovic

Електронски факултет,
Универзитет во Ниш, Србија
Faculty of Electronic Engineering,
University of Nis, Serbia

Тодор Чекеровски / Todor Cekerovski

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Далибор Серафимовски / Dalibor Serafimovski

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Мирослава Фаркаш Смиткова / Miroslava Farkas Smitková

Факултет за електротехника и информации технологии
Словачки Технички Универзитет во Братислава, Словачка
Faculty of Electrical Engineering and Information Technology
Slovak Technical University in Bratislava, Slovakia

Петер Јанига / Peter Janiga

Факултет за електротехника и информации технологии
Словачки Технички Универзитет во Братислава, Словачка
Faculty of Electrical Engineering and Information Technology
Slovak Technical University in Bratislava, Slovakia

Јана Радичова / Jana Raditschová

Факултет за електротехника и информации технологии
Словачки Технички Универзитет во Братислава, Словачка
Faculty of Electrical Engineering and Information Technology
Slovak Technical University in Bratislava, Slovakia

Драган Миновски / Dragan Minovski

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Василија Шарац / Vasilija Sarac

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Александар Тузаров / Aleksandar Tudzarov

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Владимир Талевски / Vladimir Talevski

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Владо Гичев / Vlado Gicev

Факултет за информатика,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Computer Science,
Goce Delcev University, Stip, North Macedonia;

Марија Чекеровска / Marija Cekerovska

Машински факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Mechanical Engineering,
Goce Delcev University, Stip, North Macedonia;

Мишко Цидров / Misko Dzidrov

Машински факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Mechanical Engineering,
Goce Delcev University, Stip, North Macedonia;

Александар Крстев / Aleksandar Krstev

Факултет за информатика,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Computer Science,
Goce Delcev University, Stip, North Macedonia;

Ванчо Аџиски / Vancho Adziski

Факултет за природни и технички науки,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Natural and Technical Sciences,
Goce Delcev University, Stip, North Macedonia;

Томе Димовски / Tome Dimovski

Факултет за информатички и комуникациски технологии,
Универзитет „Св. Климент Охридски“, Северна Македонија;
Faculty of Information and Communication Technologies,
University St Climent Ohridski, North Macedonia;

Зоран Котевски / Zoran Kotevski

Факултет за информатички и комуникациски технологии,
Универзитет „Св. Климент Охридски“, Северна Македонија;
Faculty of Information and Communication Technologies,
University St Climent Ohridski, North Macedonia;

Никола Рендевски / Nikola Rendeovski

Факултет за информатички и комуникациски технологии,
Универзитет „Св. Климент Охридски“, Северна Македонија;
Faculty of Information and Communication Technologies,
University St Climent Ohridski, North Macedonia;

Илија Христовски / Ilija Hristovski

Економски факултет,
Универзитет „Св. Климент Охридски“, Северна Македонија;
Faculty of Economy,
University St Climent Ohridski, North Macedonia;

Христина Спасовска / Hristina Spasovska

Факултет за електротехника и информациски технологии,
Универзитет „Св. Кирил и Методиј“, Скопје, Северна Македонија;
Faculty of Electrical Engineering and Information Technologies,
Ss. Cyril and Methodius University, North Macedonia;

Роман Голубовски / Roman Golubovski

Природно-математички факултет,
Универзитет „Св. Кирил и Методиј“, Скопје, Северна Македонија;
Faculty of Mathematics and Natural Sciences,
Ss. Cyril and Methodius University, North Macedonia;

Маре Србиновска / Mare Srbinovska

Факултет за електротехника и информациски технологии,
Универзитет „Св. Кирил и Методиј“, Скопје, Северна Македонија;
Faculty of Electrical Engineering and Information Technologies,
Ss. Cyril and Methodius University, North Macedonia;

Билјана Златановска / Biljana Zlatanovska

Факултет за информатика,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Computer Science,
Goce Delcev University, Stip, North Macedonia;

Александра Стојанова Илиевска / Aleksandra Stojanova Ilievska

Факултет за информатика,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Computer Science,
Goce Delcev University, Stip, North Macedonia;

Мирјана Коцалева Витанова / Mirjana Kocaleva Vitanova

Факултет за информатика,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Computer Science,
Goce Delcev University, Stip, North Macedonia;

Ивана Сандева / Ivana Sandeva

Факултет за електротехника и информациски технологии,
Универзитет „Св. Кирил и Методиј“, Скопје, Северна Македонија;
Faculty of Electrical Engineering and Information Technologies,
Ss. Cyril and Methodius University, North Macedonia;

Билјана Читкушева Димитровска / Biljana Citkuseva Dimitrovska

Електротехнички факултет,
Универзитет „Гоце Делчев“, Штип, Северна Македонија;
Faculty of Electrical Engineering,
Goce Delcev University, Stip, North Macedonia

Наташа Стојковиќ / Natasa Stojkovik

Факултет за информатика,

Универзитет „Гоце Делчев“, Штип, Северна Македонија;

Faculty of Computer Science,

Goce Delcev University, Stip, North Macedonia;



Трета меѓународна конференција ЕТИМА Third International Conference ETIMA

PREFACE

The Third International Conference “Electrical Engineering, Technology, Informatics, Mechanical Engineering and Automation – Technical Sciences in the Service of the Economy, Education and Industry” (ETIMA’25), organized by the Faculty of Electrical Engineering at the “Goce Delchev” University – Shtip, represents a significant scientific event that enables interdisciplinary exchange of knowledge and experience among researchers, professors, and experts in the field of technical sciences. The conference was held in an online format and brought together 78 authors from five different countries.

The ETIMA conference aims to establish a forum for scientific communication, encouraging multidisciplinary collaboration and promoting technological innovations with direct impact on modern life. Through the presentation of scientific papers, participants shared the results of their research and development activities, contributing to the advancement of knowledge and practice in relevant fields. The first ETIMA conference was organized four years ago, featuring 40 scientific papers. The second conference took place in 2023 and included over 30 papers. ETIMA’25 continued this scientific tradition, presenting more than 40 papers that reflect the latest achievements in electrical engineering, technology, informatics, mechanical engineering, and automation.

At ETIMA’25, papers were presented that addressed current topics in technical sciences, with particular emphasis on their application in industry, education, and the economy. The conference facilitated fruitful discussions among participants, encouraging new ideas and initiatives for future research and projects.

ETIMA’25 reaffirmed its role as an important platform for scientific exchange and international cooperation. The organizing committee extends sincere gratitude to all participants for their contribution to the successful realization of the conference and its scientific value.

We extend our sincerest gratitude to all colleagues who, through the presentation of their papers, ideas, and active engagement in discussions, contributed to the success and scientific significance of ETIMA’25.

The Organizing Committee of the Conference

ПРЕДГОВОР

Третата меѓународна конференција „Електротехника, Технологија, Информатика, Машинство и Автоматика – технички науки во служба на економијата, образованието и индустријата“ (ЕТИМА’25), организирана од Електротехничкиот факултет при Универзитетот „Гоце Делчев“ – Штип, претставува значаен научен настан кој овозможува интердисциплинарна размена на знаења и искуства меѓу истражувачи, професори и експерти од техничките науки. Конференцијата се одржа во онлајн формат и обедини 78 автори од пет различни земји.

Конференцијата ЕТИМА има за цел да создаде форум за научна комуникација, поттикнувајќи мултидисциплинарна соработка и промовирајќи технолошки иновации со директно влијание врз современото живеење. Преку презентација на научни трудови, учесниците ги споделуваат резултатите од своите истражувања и развојни активности, придонесувајќи кон унапредување на знаењето и практиката во релевантните области.

Првата конференција ЕТИМА беше организирана пред четири години, при што беа презентирани 40 научни трудови. Втората конференција се одржа во 2023 година и вклучи над 30 трудови. ЕТИМА’25 продолжи со истата научна традиција, презентирајќи повеќе од 40 трудови кои ги отсликуваат најновите достигнувања во областа на електротехниката, технологијата, информатиката, машинството и автоматиката.

На ЕТИМА’25 беа презентирани трудови кои обработуваат актуелни теми од техничките науки, со посебен акцент на нивната примена во индустријата, образованието и економијата. Конференцијата овозможи плодна дискусија меѓу учесниците, поттикнувајќи нови идеи и иницијативи за идни истражувања и проекти.

ЕТИМА’25 ја потврди својата улога како значајна платформа за научна размена и интернационална соработка. Организациониот одбор упатува искрена благодарност до сите учесници за нивниот придонес кон успешната реализација на конференцијата и нејзината научна вредност. Конференцијата се одржа онлајн и обедини седумдесет и осум автори од пет различни земји.

Изразуваме голема благодарност до сите колеги кои со презентирање на своите трудови, идеи и активна вклученост во дискусиите придонесоа за успехот на ЕТИМА’25 и нејзината научна вредност.

Организационен одбор на конференцијата

СОДРЖИНА / TABLE OF CONTENTS:

СОВРЕМЕНО РАНОГРАДИНАРСКО ПРОИЗВОДСТВО СО ПРИМЕНА НА ОБНОВЛИВИ ЕНЕРГЕТСКИ ИЗВОРИ И ТЕХНОЛОГИИ.....	15
ШИРОКОПОЈАСЕН ПРЕНОС НА ПОДАТОЦИ ПРЕКУ ЕЛЕКТРОЕНЕРГЕТСКАТА МРЕЖА	25
TRANSIENT PHENOMENA IN BLACK START	32
OPTIMIZATION OF SURPLUS ELECTRICITY MANAGEMENT FROM MUNICIPAL PHOTOVOLTAIC SYSTEMS: VIRTUAL STORAGE VS BATTERY SYSTEMS.....	43
IMPACT OF LIGHT POLLUTION ON ENERGY EFFICIENCY	53
ПЕРСПЕКТИВИ, ПРЕДИЗВИЦИ И ИНОВАЦИИ ВО ПЕРОВСКИТНИТЕ СОЛАРНИ КЕЛИИ	61
ПРИМЕНА НА НАНОМАТЕРИЈАЛИ КАЈ ФОТОВОЛТАИЧНИ КЕЛИИ ЗА ЗГОЛЕМУВАЊЕ НА НИВНАТА ЕФИКАСНОСТ ПРЕКУ НАМАЛУВАЊЕ НА РАБОТНАТА ТЕМПЕРАТУРА	68
LONG-TERM POWER PURCHASE AGREEMENT FOR PHOTOVOLTAIC ENERGY AS A SOLUTION FOR ENHANCING THE PROFITABILITY OF THE TASHMARUNISHTA PUMPED-STORAGE HYDRO POWER PLANT	75
СПОРЕДБЕНА АНАЛИЗА НА ПОТРОШУВАЧКА, ЕНЕРГЕТСКА ЕФИКАСНОСТ И ТРОШОЦИ КАЈ ВОЗИЛА СО РАЗЛИЧЕН ТИП НА ПОГОН	87
АВТОМАТСКИ СИСТЕМ ЗА НАВОДНУВАЊЕ УПРАВУВАН ОД ARDUINO МИКРОКОНТРОЛЕР	95
ПРИМЕНА НА WAMS И WACS СИСТЕМИ ВО SMART GRID.....	103
IoT-BASED ENVIRONMENTAL CONTROL IN 3D PRINTER ENCLOSURES FOR OPTIMAL PRINTING CONDITIONS.....	112
BENEFITS OF STUDYING 8086 MICROPROCESSOR FOR UNDERSTANDING CONTEMPORARY MICROPROCESSOR.....	123
ПРАКТИЧНА СИМУЛАЦИЈА НА SCADA СИСТЕМ ЗА СЛЕДЕЊЕ И РЕГУЛАЦИЈА НА НИВО НА ТЕЧНОСТ ВО РЕЗЕРВОАР.....	130
ADVANCEMENTS IN INDUSTRIAL DIGITAL SENSORS (VERSION 3.0 TO 4.0) AND RADAR SYSTEMS FOR OBJECT DETECTION: A STATE-OF-THE-ART REVIEW..	140
CHALLENGES AND SOLUTIONS FOR ENHANCING DRONE-TO-TOC COMMUNICATION PERFORMANCE IN MILITARY AND CRISIS OPERATIONS..	148
BRIDGING TELECOM AND AVIATION: ENABLING SCALABLE BVLOS DRONE OPERATIONS THROUGH AIRSPACE DIGITIZATION.....	157
MEASURES AND RECOMMENDATIONS FOR EFFICIENCY IMPROVEMENT OF ELECTRICAL MOTORS	167
USE OF MACHINE LEARNING FOR CURRENT DENSITY DISTRIBUTION ESTIMATION OF REBCO COATED CONDUCTORS	180
APPLICATION OF ARTIFICIAL INTELLIGENCE IN DENTAL MEDICINE	186
ИНТЕГРАЦИЈА НА ДИГИТАЛНИОТ СПЕКТРОФОТОМЕТАР ВО ДЕНТАЛНАТА МЕДИЦИНА – НОВИ МОЖНОСТИ ЗА ТОЧНОСТ И КВАЛИТЕТ	194

CORRELATION OF DENTAL MEDICINE STUDENTS' PERFORMANCE IN PRECLINICAL AND CLINICAL COURSES	205
INTRAORAL ELECTROSTIMULATOR FOR RADIATION INDUCED XEROSTOMIA IN PATIENTS WITH HEAD AND NECK CANCER	214
ELECTROMAGNETIC INTERFERENCE OF ENDODONTIC EQUIPMENT WITH GASTRIC PACEMAKER	221
DENTAL IMPLANTS ANALYSIS WITH SEM MICROSCOPE	226
ПРЕДНОСТИ И НЕДОСТАТОЦИ ПРИ УПОТРЕБА НА ЛАСЕР ВО РЕСТАВРАТИВНАТА СТОМАТОЛОГИЈА И ЕНДОДОНЦИЈА.....	231
LASERS AND THEIR APPLICATION IN PEDIATRIC DENTISTRY	238
INCREASE OF ENVIRONMENTALLY RESPONSIBLE BEHAVIOUR THROUGH EDUCATION AND TECHNOLOGICAL INNOVATION.....	242
A DATA-DRIVEN APPROACH TO REAL ESTATE PRICE ESTIMATION: THE CASE STUDY SLOVAKIA.....	249
ANALYSIS OF THE BACKWARD IMPACTS OF A PHOTOVOLTAIC POWER PLANT ON THE DISTRIBUTION SYSTEM	261
VARIANT SOLUTIONS FOR A PARKING LOT COVERED WITH PHOTOVOLTAIC PANELS.....	268
COMPARISON OF ENERGY STATUS IN PORTUGAL AND IN SLOVAKIA	279
DESIGN, ANALYSIS AND IMPLEMENTATION OF PHOTOVOLTAIC SYSTEMS ...	286
BATTERY STORAGE IN TRACTION POWER SUPPLY	297
THE ROLE OF CYBERSECURITY AWARENESS TRAINING TO PREVENT PHISHING.....	304
A REVIEW OF RESOURCE OPTIMIZATION TECHNIQUES IN INTRUSION DETECTION SYSTEMS	311
APPLICATION OF A ROBOTIC ARM IN A SIMPLE PICK-AND-DROP OPERATION	321
SIMULATION-BASED PERFORMANCE ANALYSIS OF A SECURE UAV-TO-TOC COMMUNICATION FRAMEWORK IN MILITARY AND EMERGENCY OPERATIONS	328
DIGITALIZATION OF BPM USING THE CAMUNDA SOFTWARE TOOL ON THE EXAMPLE OF THE CENTRAL BANK OF MONTENEGRO	339
DESIGNING A SECURE COMMUNICATION FRAMEWORK FOR UAV-TO-TOC OPERATIONS IN MILITARY AND EMERGENCY ENVIRONMENTS.....	349



Трета меѓународна конференција ЕТИМА

Third International Conference ETIMA

UDC: 621.311.243-11:004.94

<https://www.doi.org/10.46763/ETIMA2531286j>

DESIGN, ANALYSIS AND IMPLEMENTATION OF PHOTOVOLTAIC SYSTEMS

Sofija Jakimovska¹, Vlatko Cingoski¹

¹Faculty of Electrical Engineering, Goce Delcev University, Stip, North Macedonia

email: sofija.22576@student.ugd.edu.mk

email: vlatko.cingoski@ugd.edu.mk

Abstract

This paper presents the technical design and simulation-based performance analysis of a photovoltaic system implemented on the rooftop of a small industrial facility located in the central region of North Macedonia. The system includes 136 monocrystalline solar panels with a rated power of 545 W each, connected through two 36 kW Sungrow inverters and configured to efficiently support industrial energy demands.

Simulations were performed using PVsyst software based on real meteorological data from METEONORM, with calculated energy yield, monthly generation profiles, system losses, and performance ratio. The PV system demonstrated high efficiency, with a projected annual generation of 98 MWh and an average performance ratio exceeding 87%.

The technical solution also considers optimal panel orientation, tilt angles, cable dimensioning, and protection measures, in accordance with engineering standards. The project highlights the viability of rooftop PV systems in industrial applications as a reliable and sustainable energy source.

Key words

Photovoltaic system, PVsyst, METEONORM, solar energy, renewable energy, energy performance.

Introduction

Solar photovoltaic (PV) technology is a key driver of the global shift to renewable energy, offering a sustainable, low-emission alternative to conventional power. Its scalability, low costs, and versatility make it suitable for both large-scale and distributed systems. North Macedonia has strong solar potential, with daily irradiation above 4.0 kWh/m² in many areas, supported by national and EU renewable energy policies. Rooftop PV in industrial facilities can cut grid use, reduce costs, and boost energy independence. This study designs, simulates, and evaluates a rooftop PV system for a small facility in Sveti Nikole using METEONORM data and PVsyst modeling, assessing layout, yield, performance ratio, and losses to confirm feasibility and long-term benefits.

1. Literature review

Photovoltaic (PV) systems have been extensively studied as a sustainable solution for electricity generation in residential, commercial, and industrial sectors. Numerous studies [6], [10] have shown that system performance strongly depends on local climatic conditions, optimal orientation and tilt angles, and the quality of installed components. Accurate design and simulation are essential for maximizing efficiency, with PVsyst being one of the most widely used tools for performance estimation and loss analysis [8].

In industrial applications, research demonstrates that large-scale rooftop PV systems can significantly reduce operational costs and improve energy self-sufficiency, particularly when integrated with the grid under net metering policies [2], [1]. For regions with high solar irradiation, such as the Mediterranean and Balkan areas, performance ratios (PR) between 80% and 88% are commonly reported, with variations influenced by shading, temperature effects, and maintenance practices [1], [6], [8].

Although several studies have investigated PV system optimization using meteorological databases such as METEONORM [5], there is limited literature focusing on small-to-medium industrial facilities in central North Macedonia. This paper addresses that gap by designing and evaluating a grid-connected PV system for an industrial site in Sveti Nikole. The research integrates real meteorological data, detailed technical specifications, and simulation-based analysis to validate the system's performance and assess its potential for wider deployment in similar climatic regions.

2. Methodology

2.1 Site Selection & Climatic Data

The photovoltaic system is located in Sveti Nikole, in the central region of North Macedonia (41.86°N , 21.94°E). This area benefits from high solar potential, with average daily global horizontal irradiation exceeding 4.2 kWh/m^2 . Such conditions make it highly suitable for photovoltaic energy generation.



Fig. 1 Solar potential map of North Macedonia

Source: author based on [12]

Meteorological data for the site were obtained from the METEONORM 9.1.0.13 database for the period 1981–2000. The results indicate strong seasonal variation in solar radiation, with the highest values observed during the summer months.

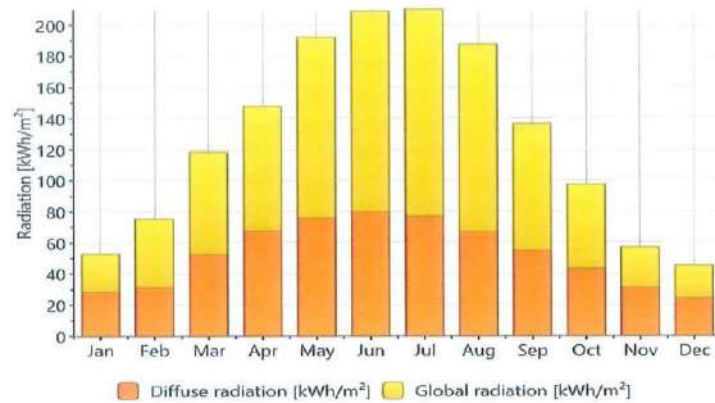


Fig. 2 Average solar radiation according to METEONORM
Source: author based on [5]

These favorable climatic conditions provide a strong foundation for achieving high energy yields from the PV system and ensure the economic viability of the project.

2.2 System Design Parameters

The photovoltaic system is mounted on the existing gable roof of the facility, with a total usable surface area of approximately 722 m². The roof has a tilt of 6° relative to the horizontal plane and is divided into two main fields with different orientations:

- Field 1: +34.0° (south-east facing)
- Field 2: -146.0° (south-west facing)

These orientations affect the angle of incidence of solar radiation and overall energy production.

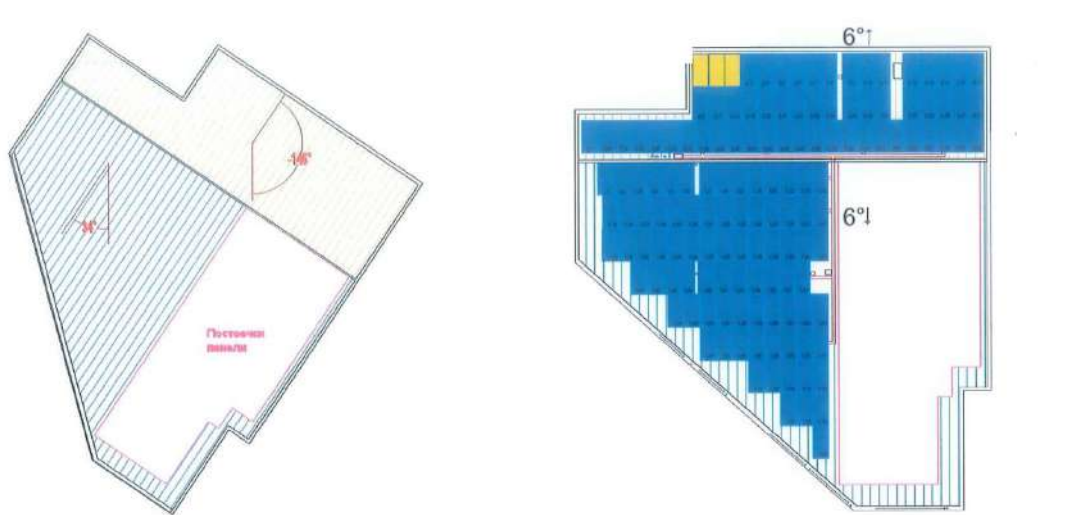


Fig. 3 Roof sketches showing orientation angles (left) and photovoltaic module layout (right)

The PV array consists of monocrystalline modules manufactured by JA Solar, model JAM72S30-545/MR, each with a rated power output of 545 W. The panels are arranged in two zones according to roof orientation. Detailed panel specifications are provided in Table 1.

Table 1: Technical specifications of the photovoltaic module

Parameter	Unit	Value
Maximum Power P _{max}	[W]	545
Voltage at Maximum Power U _{mpp}	[V]	41.8
Current at Maximum Power I _{mpp}	[A]	13.04
Open Circuit Voltage U _{oc}	[V]	49.75
Short Circuit Current I _{sc}	[A]	13.86
Efficiency	[%]	21.5
Operating Temperature Range	[°C]	-40 ÷ +85
Maximum System Voltage	[V]	1500
Dimensions	[mm]	2278 × 1134 × 35
Weight	[kg]	28.6
Temperature Coefficient (P _{max})	[%/°C]	-0.45

Source: author based on [3]

The system uses two three-phase string inverters, model Sungrow SG36KTL-M, each with a nominal AC output power of 36 kW and equipped with 3 MPPT inputs and a maximum efficiency above 98%. These inverters ensure high conversion efficiency and flexibility in connecting multiple strings. Technical specifications are listed in Table 2.

Table 2: Technical specifications of the Sungrow SG36KTL-M inverter

Parameter	Unit	Value
Maximum input voltage	V	950
MPP voltage operating range	V	200–950
Nominal AC output power	W	36,000
Nominal voltage	V	400
Maximum output current	A	48
Number of inputs / MPP trackers	–	8 / 3
Efficiency (Max / Euro)	%	98.5 / 98.3
Protection rating	–	IP 65

Source: author based on [11]

2.3 Electrical Configuration

String layout: The PV array is divided into 8 strings, each with 17 modules in series. Strings are grouped 4+4 and connected to two three-phase string inverters (Sungrow SG36KTL-M, 36 kW each). This corresponds to ≈37 kW DC per inverter and 72 kW total AC at the point of common coupling.

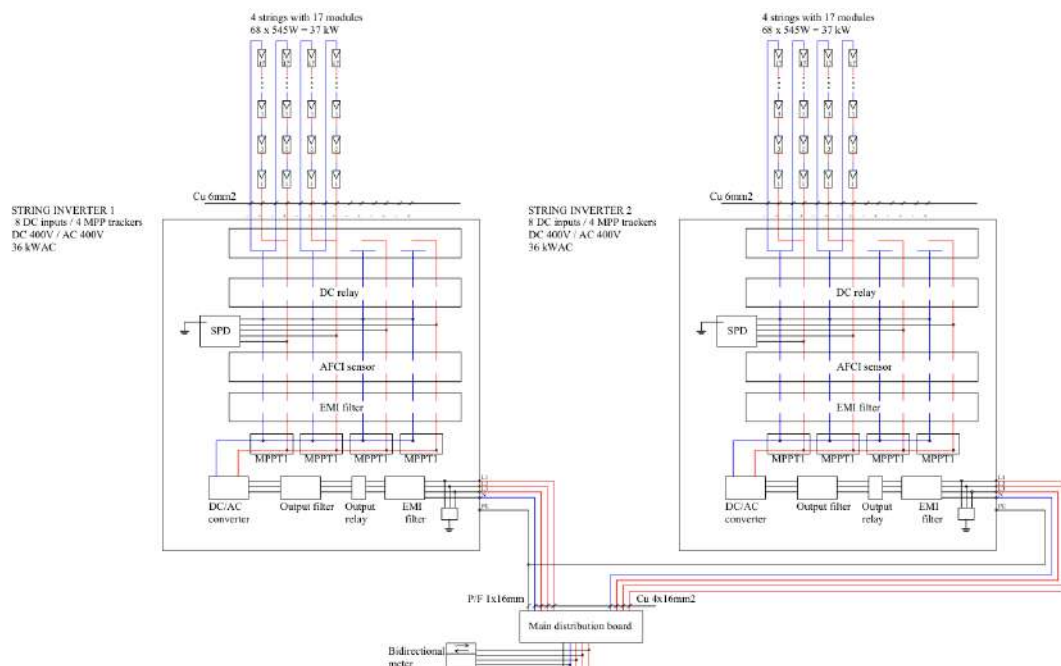


Fig.4 Electrical single-line diagram of the PV system

DC cabling: string home-runs use PV1-F Cu 6 mm² outdoor-rated solar cable with MC-type connectors. Cables are routed in roof trays to each inverter's DC terminals. Overcurrent protection and DC surge protection (SPD) are integrated in the inverters; no external DC combiner is required.

AC cabling and metering: each inverter's AC output is protected by breakers and routed with Cu 4×16 mm² cable to the main LV switchboard via the stairwell shaft. A bi-directional energy meter records import/export for grid settlement (net metering).

Grounding and bonding: all metallic parts (module frames, rails, inverters, AC panels) are bonded to the common PE. The mounting structure is tied to the earth grid at least every 10 m. If the resistance to earth exceeds 10 Ω, additional bonding/electrodes are installed. All grounding joints are anti-corrosion protected (bituminous coating).

Lightning and surge protection: the building's external LPS protects the roof area. Internal protection includes equipotential bonding, SPD coordination at inverter inputs/outputs, and cable routing that minimizes loop areas.

Electrical schematic: the single-line diagram summarizing strings, inverter DC/AC interfaces, protection, and grid interconnection should be inserted here as Figure 3.

3.4 Simulation Setup

The performance assessment of the photovoltaic system was carried out using PVsyst software, which enables detailed modeling of PV systems based on geographic location, system design parameters, and meteorological data. The simulation inputs were derived from METEONORM 9.1.0.13 climatic data for the project site in Sveti Nikole.

PVsyst modeling process. The model was configured with the exact roof geometry, module specifications (JA Solar JAM72S30-545/MR), inverter parameters (Sungrow SG36KTL-M),

string layout, tilt, and azimuth angles for each zone. Separate sub-arrays were defined for the two roof orientations ($+34^\circ$ and -146° azimuth).

Shading analysis. The near-shading scene was constructed in PVsyst to evaluate possible shading losses from surrounding structures and the roof geometry. The iso-shading diagrams for both orientations are shown in Figure 5 and Figure 6.

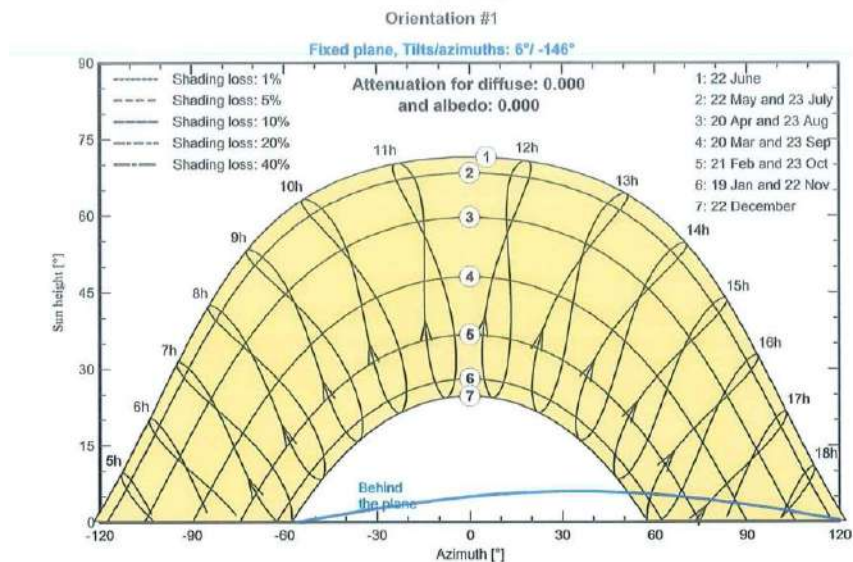


Fig. 5 Solar path and shading analysis – Orientation #1 (azimuth -146°)

Source: author based on PVsyst simulation results

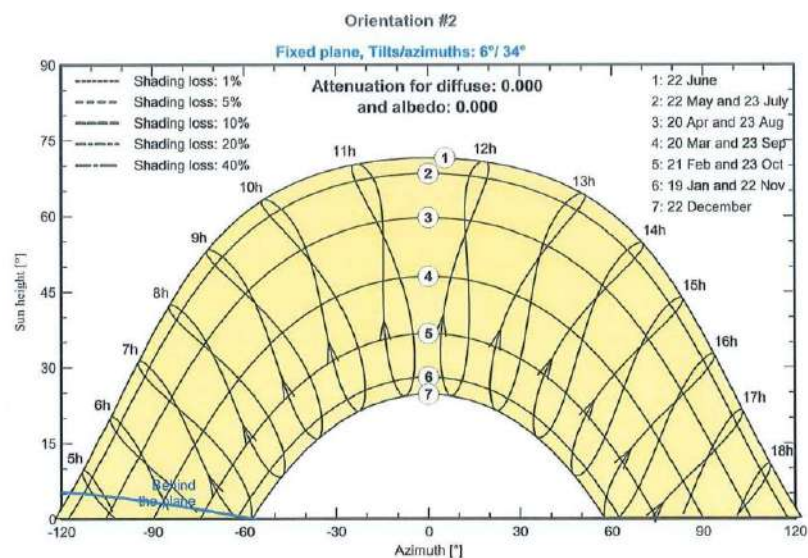


Fig. 6 Solar path and shading analysis – Orientation #2 (azimuth $+34^\circ$)

Source: author based on PVsyst simulation results

Input assumptions.

- Loss factors: Mismatch losses (2.10%), ohmic wiring losses (0.87%), angular losses (0.02%), low-irradiance losses (1.50%), and module quality gain (+0.75%).

- Temperature effects: PV module temperature coefficient applied according to datasheet, resulting in ~5.32% annual loss due to high operating temperatures.
- Inverter efficiency: Maximum/Euro efficiency 98.5% / 98.3%.
- Performance ratio (PR): Calculated monthly and annually to quantify system efficiency excluding environmental factors.

These settings ensured that the simulation closely represented expected real-world conditions, providing reliable performance and loss estimations for the designed PV system.

3. Results and Discussion

3.1 Energy Yield Analysis

The PVsyst simulation results indicate that the photovoltaic system achieves high performance, with notable differences between the two roof orientations. Zone 1 (+36° azimuth) produced the highest specific yield due to its more favorable orientation, while Zone 2 (−146° azimuth) demonstrated slightly lower productivity. The annual energy production per zone is summarized in Table 3.

Table 3: PV zone parameters and calculated annual energy yield

Zone	Panel Orientation [°]	Panel Tilt α [°]	Shading Angle β [°]	Number of Panels	Installed Capacity [kW]	Annual Irradiation on Plane [kWh/m ²]	Specific Production [kWh/kWp]	Annual Production [MWh]
1	+36	6	0	80	43.60	1505	1375	60,00
2	-146	6	0	56	30.52	1505	1259	38.40
Total	—	—	—	136	126	—	1317	172.00

Source: author based on PVsyst simulation results

Overall, the system's total installed DC capacity is 74.1 kWp, with an expected annual AC energy yield of approximately 98.7 MWh, corresponding to an average specific production of 1,317 kWh/kWp/year.

The monthly production trend is illustrated in Figure 7. Monthly energy production of the PV system, which shows peak generation in May, June, and July, and lower values during winter months due to reduced irradiance.

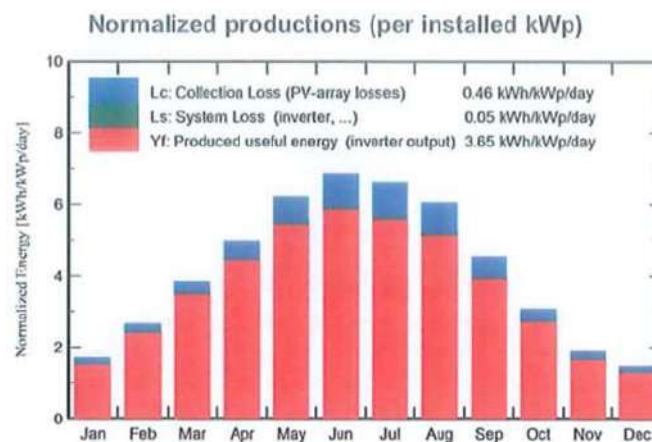


Fig. 7 Normalized daily production per installed kWp

Source: author based on PVsyst simulation results

The simulation data confirm that seasonal variability is strongly correlated with solar resource availability and roof orientation. The overall production profile aligns with regional climatic conditions, and the system design effectively maximizes yield within the site constraints.

3.2 Performance Ratio and Losses

The Performance Ratio (PR) is a key metric that reflects the overall efficiency of a PV system, excluding the influence of local solar resource availability. For the analyzed system, the PR remained consistently high throughout the year, ranging between 84% and 92%, with an annual average of 0.877.

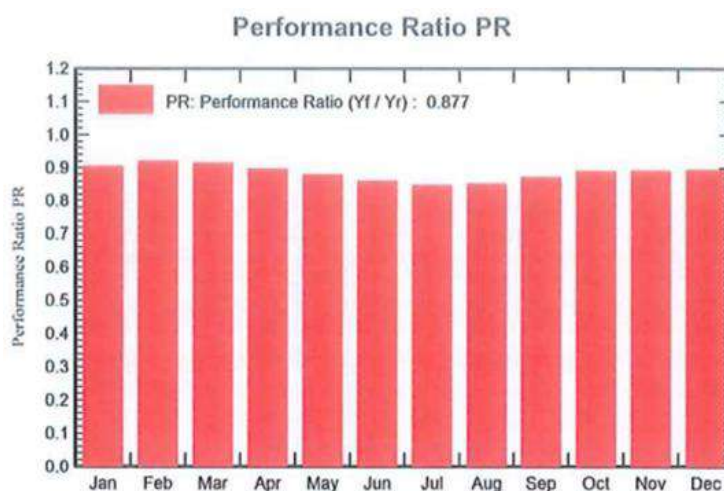


Fig. 8 Monthly Performance Ratio of the PV system
Source: author based on PVsyst simulation results

The detailed energy loss analysis from PVsyst is shown in Figure 9. Loss diagram of the PV system. The largest losses are associated with high operating temperatures (5.32%), mismatch between modules and strings (2.10%), and wiring losses (0.87%). Collection losses from the PV array amount to 0.46 kWh/kWp/day, and inverter/system losses are limited to 0.05 kWh/kWp/day.

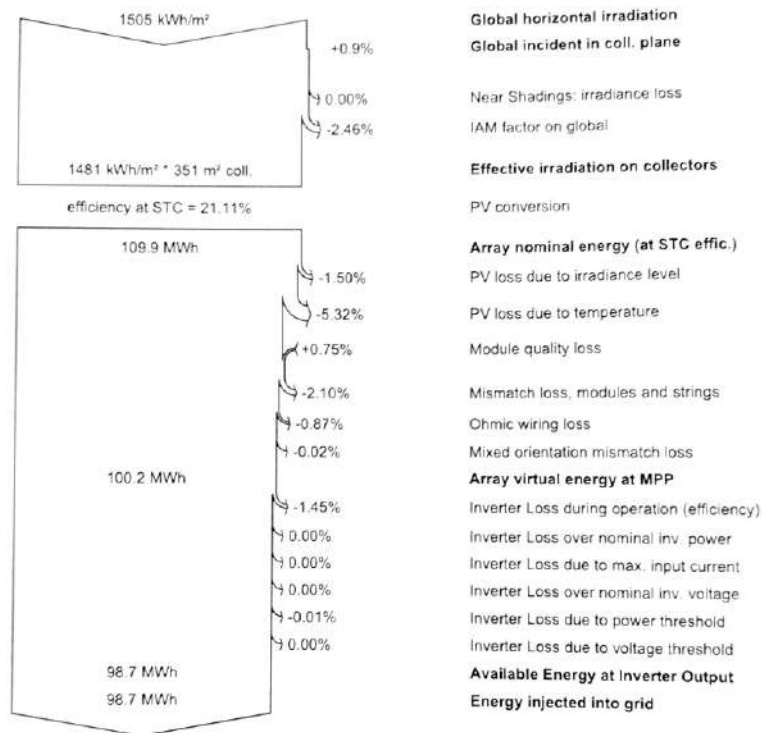


Fig. 9 Energy loss diagram of the PV system

Source: author based on PVsyst simulation results

These results indicate that the system has been designed with high-quality components and optimized configuration, resulting in minimal system losses and stable year-round performance.

3.3 Correlation and Output Distribution

The correlation between daily global irradiation and daily energy delivered to the grid is presented in Figure 10. Correlation between daily irradiation and delivered energy. The results show a strong and nearly linear relationship, confirming that increases in solar irradiation directly translate to higher energy yields. Minimal data scatter indicates consistent system operation and the absence of significant performance fluctuations under varying weather conditions.

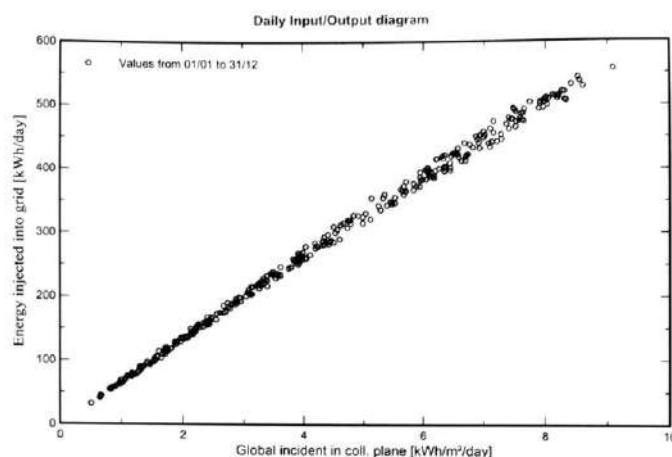


Fig. 10 Correlation between daily solar irradiation and energy injected into the grid

Source: author based on PVsyst simulation results

The distribution of daily output power over the year is illustrated in Figure 11. Histogram of daily delivered power to the grid. Most operating days fall within the 30–55 kW range, which corresponds well with the nominal AC capacity of the system (72 kW from two 36 kW inverters). Peak outputs around 40–50 kW dominate, with occasional maximum values approaching 60 kW during periods of high solar resource availability.

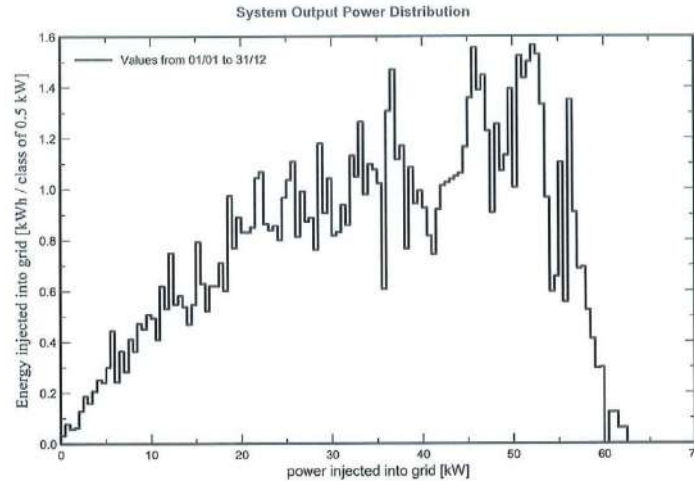


Fig. 11 Distribution of daily AC power injected into the grid

Source: author based on PVsyst simulation results

This analysis demonstrates that the system consistently operates in its optimal power range for a significant portion of the year, while seasonal and irradiance variations drive expected changes in daily production.

3.4 Technical Observations

The two roof orientations ($+36^\circ$ and -146° azimuth) with a fixed tilt of 6° resulted in measurable performance differences. Zone 1 ($+36^\circ$) achieved a higher specific yield (1,375 kWh/kWp/year) compared to Zone 2 (1,259 kWh/kWp/year), highlighting the importance of azimuth alignment for maximizing energy capture.

High ambient temperatures during summer months had a moderate impact on performance, with an estimated 5.32% annual energy loss due to the negative temperature coefficient of the PV modules. Shading analysis confirmed minimal obstruction for both orientations, with negligible shading losses.

Electrical losses were also kept low through optimized design. Cable losses were limited to 0.87% by using adequately sized conductors (PV1-F Cu 6 mm² for DC, Cu 4×16 mm² for AC). Mismatch losses between modules and strings accounted for 2.10%, a typical value for systems with multiple orientations. The inverters achieved high conversion efficiency, with Max/Euro efficiencies of 98.5% / 98.3%, minimizing conversion losses to 1.45%.

Overall, the combination of favorable design choices, quality components, and minimal shading ensures stable, high-efficiency operation, supporting the projected annual yield and long-term reliability of the PV system.

4. Conclusions

The designed photovoltaic system for the industrial facility in Sveti Nikole demonstrates high technical performance and operational stability. Based on PVsyst simulations using site-specific meteorological data, the system is expected to deliver an annual yield of approximately 98 MWh with an average Performance Ratio (PR) of 87.7%.

Loss analysis confirmed that the system operates near optimal efficiency, with minimal losses attributed to temperature effects, mismatch, and cabling. The combination of favorable site conditions, optimized panel orientation, and high-efficiency inverters ensures reliable year-round operation.

From an industrial perspective, the system will significantly reduce grid electricity consumption and operational energy costs, while contributing to environmental sustainability through reduced greenhouse gas emissions.

Future developments could include the integration of battery energy storage to improve self-consumption rates and supply continuity, as well.

References

- [1]Freris, Leon / Infield, David: *Renewable Energy in Power Systems*. Wiley: Chichester 2008.
- [2]Gordon, Jeffrey M. (ed.): *Solar Energy: The State of the Art*. Earthscan Publications: London 2001.
- [3]JA Solar Technology Co., Ltd.: JAM72S30-545/MR Monocrystalline PV Module Datasheet. JA Solar Technology Co., Ltd.: Beijing 2023.
- [4]Masters, Gilbert M.: *Renewable and Efficient Electric Power Systems*. Wiley-Interscience: Hoboken, NJ 2004.
- [5]Meteotest: METEONORM 9.1.0.13 – Global Meteorological Database for Engineers, Planners and Education. Meteotest: Bern 2020.
- [6]Mohammadi, Shir Ahmad Dost / Gezezin, Cenk: “Design and simulation of grid-connected solar PV system using PVsyst, PVGIS and HOMER software”. *International Journal of Pioneering Technology and Engineering*, Vol. 1, No. 1. *International Journal of Pioneering Technology and Engineering*: June 2022, pp. 36–41.
- [7]Mukherjee, D., Chakrabarti, S.: *Fundamentals of Renewable Energy Systems*. 2nd ed. New Age International Publishers: New Delhi 2005.
- [8]PVsyst SA: PVsyst – Software for Photovoltaic System Design and Simulation. Retrieved June 18, 2025, from <https://www.pvsyst.com>
- [9]Sawhney, G.S.: *Non-Conventional Energy Resources*. PHI Learning Private Limited: New Delhi 2012.
- [10]Serat, Zainullah / Fatemi, Sayed Ahmad Zamir / Shirzad, Safiullah: “Design and economic analysis of on grid solar rooftop PV system using PVsyst software”. *Archives of Advanced Engineering Science*, Vol. 1, No. 1. Bon View Publishing: July 2023, pp. 63–76.
- [11]Sungrow Power Supply Co., Ltd.: SG36KTL-M String Inverter Datasheet. Sungrow Power Supply Co., Ltd.: Hefei 2023.
- [12]World Bank Group / ESMAP: *Solar Resource Map – Photovoltaic Power Potential, North Macedonia*. World Bank Group: Washington, D.C. 2020.